


DESCRIPTION REV. DATE BY

TYPE CALE-1E				
CAST ALUMINUM SPRING ISOLATORS FOR 1" NOMINAL DEFLECTION				
MODEL	MAX LOAD	DEFLECTION	SPRING RATE	SPRING
	(LBS)	(IN)	(LB/IN)	COLOR CODE
CALE-1E-195	195	1.95	100	DK BLUE
CALE-1E-400	400	1.32	303	BLACK
CALE-1E-530N <sup>1</sup>	530	1.17	453	BLACK/ DK BLUE
CALE-1E-650	650	1.05	620	RED
CALE-1E-825N <sup>1</sup>	825	1.07	770	RED/ DK BLUE
CALE-1E-1000	1000	1.00	1000	TAN
CALE-1E-1200N <sup>1</sup>	1200	1.04	1150	TAN/ DK BLUE
CALE-1E-1400	1400	1.00	1400	PINK
CALE-1E-1700N <sup>1</sup>	1700	1.10	1550	PINK/ DK BLUE
CALE-1E-2000	2000	1.11	1800	WHITE
CALE-1E-2330N <sup>1</sup>	2330	1.11	2100	WHITE/ RED
CALE-1E-2575N <sup>1</sup>	2575	1.11	2313	WHITE/DK PURPLE
CALE-1E-2990N <sup>1</sup>	2990	1.12	2681	WHITE/DK GREEN
CALE-1E-3250N <sup>1</sup>	3250	1.04	3127	WHITE/GRAY

## NOTES:

1. TWO NESTED SPRINGS YIELD THIS LOAD. THE COLOR CODE IS FOR OUTER SPRING/ INNER SPRING.



ISOLATOR SELECTIONS		
LOC 1:	LOC 2:	
LOC 3:	LOC 4:	
LOC 5:	LOC 6:	
LOC 7:	LOC 8:	
CUSTOMER EQP'T. TAG:		

NOTE: MATERIAL SHOWN IS FOR (1) SET.

- 2. UNLESS OTHERWISE NOTED, DIMENSIONS FOR STYLE APPLY TO ALL OTHER STYLES.
- 3. FINISH: HOUSINGS-CAST ALUMINUM, SPRINGS-POWER COAT, HARDWARE- ZINC ELECTROPLATE.
- 4. REFER TO SHEET 2 OF 2 FOR INSTALLATION INSTRUCTIONS.
- 5. INNER SPRING (WHEN USED) NOT SHOWN.
- 6. ALL SPRINGS ARE DESIGNED WITH 50% OVER TRAVEL.
- 7. DETAILS NOT SHOWN ON OTHER VIEW FOR CLARITY.
- 8. RATED DEFLECTIONS ARE WITHIN 25% OF NOMINAL. HIGHER DEFLECTIONS ARE ALLOWED IF THEY MEET SPECIFICATIONS.

THER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIO	R
ROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.	

CERTIFIED FOR:  JOB NAME:  CUSTOMER :  CUSTOMER P.O.:	MODEL CALE-1E 195-3250 LBS. ALUM. SPRING ISOLATORS SNUBBED WITH EXTERNAL ADJUSTMENT 1 INCH DEFLECTION	THE VMC GROUP The Power of Together Planning data NJ 07402	SCALE: NONE SHEET: DRAWING NO.:	Memb	
SALES ORDER:	T INOTE DEL CEOTION	Bloomingdale, NJ 07403 Houston, TX 77041			
ROPRIETARY: EXCEPT AS OTHERWISE AGREED IN WRITING, THE INFORMATION AND DESIGN DISC	LOSED HEREIN ARE THE PROPERTY OF THE VMC GROUP AND MUST NOT BE COPIED OR DISTRIBUTED OUTSI	OF THE VMC GROUP EXCEPT TO AUTHO	RIZED PERSONS WITH A GE	NUME NEED TO KNO	OW.

120R-101687 REV.: 5 REV. DESCRIPTION DATE BY


## READ INSTRUCTIONS IN THEIR ENTIRETY BEFORE BEGINNING.

ALL VMC GROUP ISOLATORS ARE SHIPPED ASSEMBLED AND IDENTIFIED BY SIZE (LOAD CARRYING CAPACITY) AND BY THE COLOR CODE ON THE SPRINGS. THE NORMAL INSTALLATION AND ADJUSTMENT OF TYPE CALE ISOLATOR IS AS FOLLOWS:

- 1. LOCATE THE ISOLATORS IN THEIR PROPER POSITION UNDER THE EQUIPMENT. SEE SUBMITTAL DATA, INSTALLATION DRAWINGS, OR OTHER CORRESPONDENCE FOR CORRECT LOCATION OF ISOLATORS WHEN DIFFERENT CAPACITY ISOLATORS ARE USED FOR UNEQUAL LOAD DISTRIBUTION. ISOLATORS SHOULD BE SET ON A FLAT, LEVEL SURFACE AT THE SAME ELEVATION. SHIMS, IF REQUIRED, SHOULD BE FULL SIZE.
- 2. BEFORE THE ISOLATORS ARE ADJUSTED, THE WEIGHT OF THE EQUIPMENT MAY CAUSE THE TOP PLATE TO COME TO REST ON THE HOUSING. THE ISOLATORS SHOULD BE ADJUSTED TO PROVIDE A MINIMUM CLEARANCE OF 1/4" BETWEEN THE TOP PLATE AND THE HOUSING.
- 3. INSTALL THE ADJUSTING AND LEVELING BOLTS THROUGH EQUIPMENT ISOLATING HOLES UNTIL THE BOLT COMES INTO CONTACT WITH SPRING CUP. BACK OFF THE LOCK NUT AND COMPRESS THE SPRINGS BY TURNING THE ADJUSTING BOLT "A" CLOCKWISE. START AT ONE ISOLATOR AND MAKE FOUR TURNS ON THE ADJUSTING BOLT "A". MOVE TO THE NEXT ISOLATOR AND MAKE FOUR TURNS, ETC., UNTIL ALL ISOLATORS HAVE BEEN ADJUSTED FOUR TURNS. REPEAT THIS PROCEDURE UNTIL A 1/4" GAP IS OBTAINED BETWEEN TOP PLATE AND HOUSING.
- 4. CHECK THE LEVEL OF THE EQUIPMENT. THE EQUIPMENT MAY NOW BE LEVELED BY MAKING SMALL ADJUSTMENTS OF INDIVIDUAL ISOLATORS AT THE HIGH AND LOW POINTS.
- 5. AFTER THE EQUIPMENT IS LEVEL. VISUALLY CHECK EACH ISOLATOR TO MAKE SURE SPRING COILS ARE NOT CLOSED SOLID AND THERE IS SUFFICIENT CLEARANCE BETWEEN TOP PLATE AND HOUSING.

## NOTES:

- ALTHOUGH PROVISIONS HAVE BEEN MADE FOR ANCHOR BOLTS, THE NON-SKID ELASTOMERIC PAD ON THE BOTTOM OF THE ISOLATOR IS USUALLY SUFFICIENT TO PREVENT "WALKING" OF EQUIPMENT, AND NO BOLTING IS REQUIRED.
- IF ISOLATOR MUST BE BOLTED TO SUPPORTING STRUCTURE, BOLTS SHOULD BE HAND-TIGHT.DO NOT OVER-TIGHTEN.

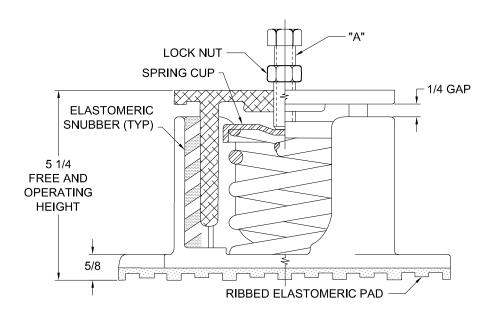

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:	
JOB NAME:	l
CUSTOMER:	ALU
CUSTOMER P.O.:	
SALES ORDER:	

MODEL CALE-1E 195-3250 LBS. UM. SPRING ISOLATORS SNUBBED WITH EXTERNAL ADJUSTMENT 1 INCH DEFLECTION

		Z	
THE	VMC	GRO	_ 

The Power of Together Bloomingdale, NJ 07403 Houston, TX 77041

NONE SHEET:

□ DRAWING NO.:

REVISION