

3. FINISH: HOUSINGS-CAST ALUMINUM. SPRINGS-POWER COAT. HARDWARE-ZINC ELECTROPLATE.


8. RATED DEFLECTIONS ARE WITHIN 25% OF NOMINAL, HIGHER DEFLECTIONS ARE ALLOWED IF THEY MEET SPECIFICATIONS.

REV.	DESCRIPTION	DAIL	ВТ
RFV	DESCRIPTION	DATE	RY

TYPE CALP-1D				
CAST ALUMINUM SPRING ISOLATORS FOR 1" NOMINAL DEFLECTION				
MODEL	MAX LOAD	DEFLECTION	SPRING RATE	SPRING
WODLE	(LBS)	(IN)	(LB/IN)	COLOR CODE
CALP-1D-85	85	1.35	63	LT PURPLE
CALP-1D-120	120	1.20	100	DK YELLOW
CALP-1D-175	175	1.17	150	DK BLUE
CALP-1D-250	250	1.40	179	YELLOW
CALP-1D-340	340	1.13	300	RED
CALP-1D-510	510	1.02	500	BLACK
CALP-1D-675	675	1.32	513	DK PURPLE
CALP-1D-900	900	1.02	881	DK GREEN
CALP-1D-1200	1200	0.90	1327	GRAY
CALP-1D-1360	1360	0.77	1758	WHITE
CALP-1D-1785N <sup>1</sup>	1785	0.88	2029	GRAY/RED

## NOTES:

1. TWO NESTED SPRINGS YIELD THIS LOAD. THE COLOR CODE IS FOR OUTER SPRING/ INNER SPRING.



ISOLATOR SELECTIONS			
190EATOR SELECTIONS			
LOC 1:	LOC 2:		
LOC 3:	LOC 4:		
LOC 5:	LOC 6:		
LOC 7:	LOC 8:		
CUSTOMER EQP'T. TAG:	•		

NOTE: MATERIAL SHOWN IS FOR (1) SET.

## **CERTIFIED FOR:**

JOB NAME: CUSTOMER: CUSTOMER P.O.: SALES ORDER:

4. REFER TO SHEET 2 OF 2 FOR INSTALLATION INSTRUCTIONS.

6. ALL SPRINGS ARE DESIGNED WITH 50% OVER TRAVEL. 7. DETAILS NOT SHOWN ON OTHER VIEW FOR CLARITY.

5. INNER SPRING (WHEN USED) NOT SHOWN.

MODEL CALP-1D 85-1785 LBS. ALUM, SPRING ISOLATORS SNUBBED WITH INTERNAL ADJUSTMENTS AND POSITIONING PIN 1 INCH DEFLECTION

			1
	=		
THE	VMC	GRO	ШF

The Power of Together

Bloomingdale, NJ 07403 Houston, TX 77041

NONE SHEET:

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR

PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

□ DRAWING NO.: REVISION 120R-101685 REV.: 4 REV. DESCRIPTION DATE BY


## READ INSTRUCTIONS IN THEIR ENTIRETY BEFORE BEGINNING.

ALL VMC GROUP HOUSED ISOLATORS ARE SHIPPED ASSEMBLED AND IDENTIFIED BY SIZE (LOAD CARRYING CAPACITY) AND BY THE COLOR CODE ON THE SPRINGS. THE NORMAL INSTALLATION AND ADJUSTMENT OF THIS TYPE ISOLATOR IS AS FOLLOWS:

- 1. LOCATE THE ISOLATORS IN THEIR PROPER POSITION UNDER THE EQUIPMENT. SEE SUBMITTAL DATA, INSTALLATION DRAWINGS, OR OTHER CORRESPONDENCE FOR CORRECT LOCATION OF ISOLATORS WHEN DIFFERENT CAPACITY ISOLATORS ARE USED FOR UNEQUAL LOAD DISTRIBUTION, ISOLATORS SHOULD BE SET ON A FLAT, LEVEL SURFACE AT THE SAME ELEVATION. SHIMS, IF REQUIRED, SHOULD BE FULL SIZE.
- 2. BEFORE THE ISOLATORS ARE ADJUSTED, THE WEIGHT OF THE EQUIPMENT MAY CAUSE THE TOP PLATE TO COME TO REST ON THE HOUSING. THE ISOLATORS SHOULD BE ADJUSTED TO PROVIDE A MINIMUM CLEARANCE OF 1/4" BETWEEN THE TOP PLATE AND THE HOUSING.
- COMPRESS THE SPRINGS BY TURNING THE ADJUSTING NUT "A" CLOCKWISE. START AT ONE ISOLATOR AND MAKE FOUR TURNS ON THE ADJUSTING NUT "A". MOVE TO THE NEXT ISOLATOR AND MAKE FOUR TURNS, ETC., UNTIL ALL ISOLATORS HAVE BEEN ADJUSTED FOUR TURNS. REPEAT THIS PROCEDURE UNTIL A 1/4" GAP IS OBTAINED BETWEEN TOP PLATE AND HOUSING.
- 4. CHECK THE LEVEL OF THE EQUIPMENT. THE EQUIPMENT MAY NOW BE LEVELED BY MAKING SMALL ADJUSTMENTS OF INDIVIDUAL ISOLATORS AT THE HIGH AND LOW POINTS.
- 5. AFTER THE EQUIPMENT IS LEVEL, VISUALLY CHECK EACH ISOLATOR TO MAKE SURE SPRING COILS ARE NOT CLOSED SOLID AND THERE IS SUFFICIENT CLEARANCE BETWEEN TOP PLATE AND HOUSING.

## NOTES:

- 1. ALTHOUGH PROVISIONS HAVE BEEN MADE FOR ANCHOR BOLTS. THE NON-SKID ELASTOMERIC PAD ON THE BOTTOM OF THE ISOLATOR IS USUALLY SUFFICIENT TO PREVENT "WALKING" OF EQUIPMENT, AND NO BOLTING IS REQUIRED.
- 2. IF ISOLATOR MUST BE BOLTED TO SUPPORTING STRUCTURE, BOLTS SHOULD BE HAND-TIGHT. DO NOT OVER-TIGHTEN.

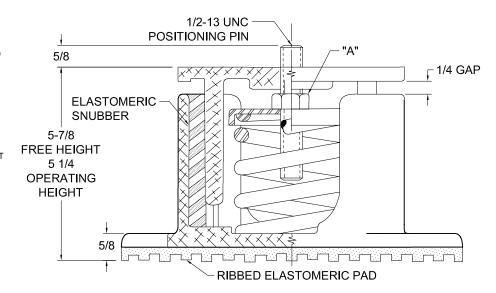

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:		
JOB NAME:		
CUSTOMER:		
CUSTOMER P.O.:		
SALES ORDER:		

MODEL CALP-1D 85-1785 LBS. ALUM. SPRING ISOLATORS SNUBBED WITH INTERNAL ADJUSTMENTS AND POSITIONING PIN 1 INCH DEFLECTION

<u> </u>		7	
THE	VMC	GRO	ı U I

SHEET:

The Power of Together Bloomingdale, NJ 07403 Houston, TX 77041

NONE

□ DRAWING NO.:

REVISION