



REV.	DESCRIPTION	DATE	BY

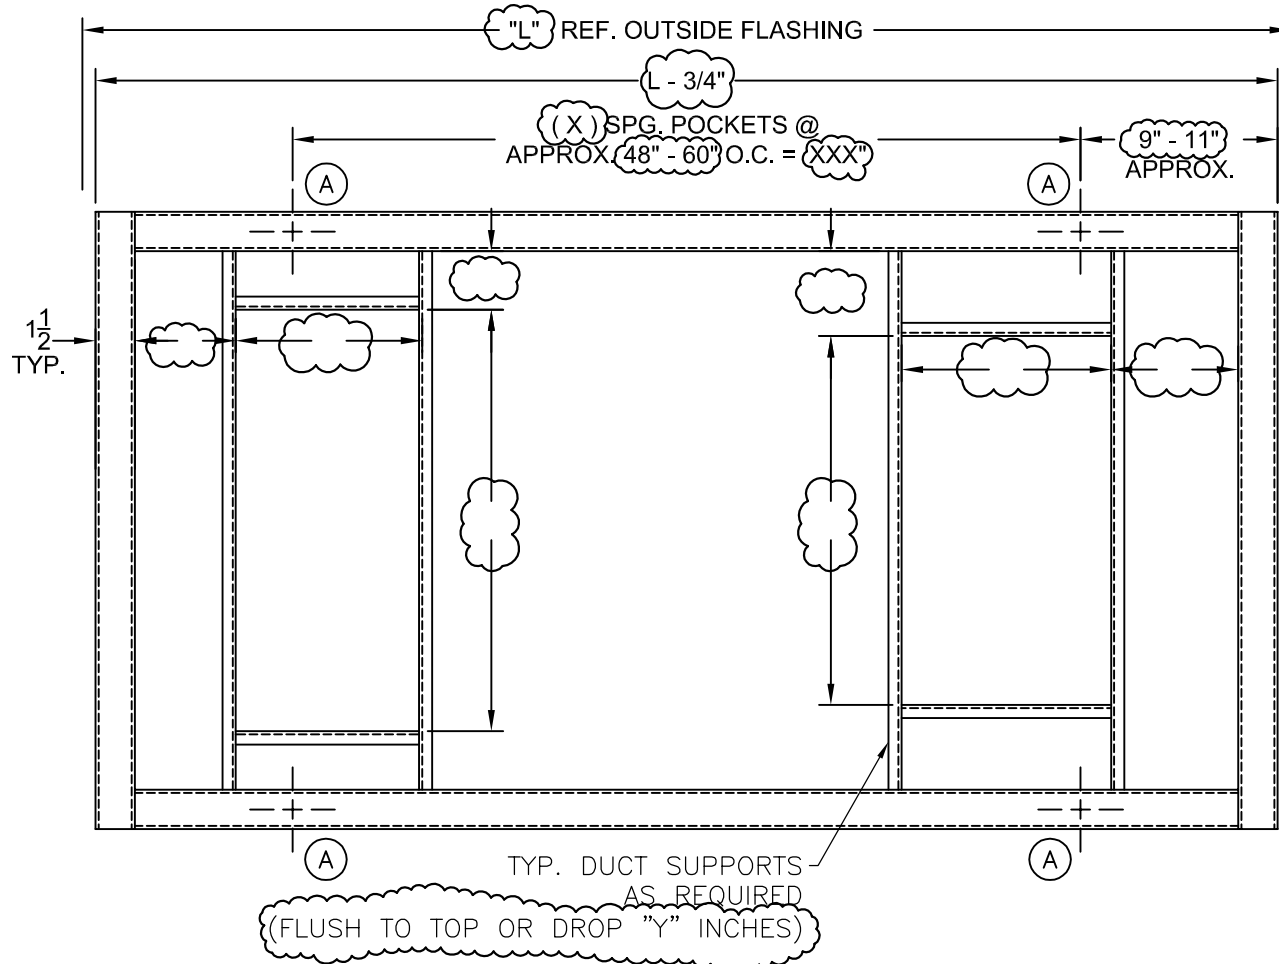

CURB DATA

TOTAL CURB WEIGHT: _____
 QUANTITY: _____
 SHIPPED IN _____ SECTION(S)
 LOWER RAIL O.A. DIMENSIONS: (L-3/4)x(W-3/4)
 CURB HEIGHT: _____
 CURB LINEAL FOOTAGE: _____

SPRING POCKET LOCATION	SPRING IDENT. NO.	MAX. RATED LOAD PER POCKET	MAX. DEFL. (IN.)
A	T2Q-	XXX#	2.0

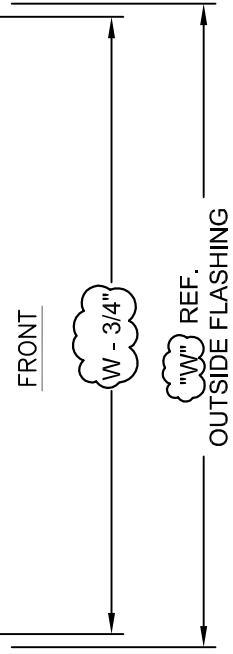

TYP. DUCT SUPPORTS AS REQUIRED
 (FLUSH TO TOP OR DROP "Y" INCHES)

OPTIONS

YES	NO	
<input type="checkbox"/>	<input type="checkbox"/>	SEISMIC/WIND CONSIDERATION
<input type="checkbox"/>	<input type="checkbox"/>	SOUND BARRIER PKG.
<input type="checkbox"/>	<input type="checkbox"/>	CONDENSING UNIT RAIL PER DWG. NO. _____
<input type="checkbox"/>	<input type="checkbox"/>	DUCT SUPPORT PKG.

TAG: _____
 MANUFACTURER: _____
 MODEL NUMBER: _____
 OPERATING WEIGHT: _____

NOTE: ENGINEER SHALL FILL IN ALL VARIABLES PRIOR TO SUBMISSION. IF ANY VARIABLES ARE MISSING, MARK DWG AS "PRELIMINARY" AND SUBMIT. REMOVE BALLOONS AND THIS NOTE

- NOTES:
1. ROOFING AND INSULATION TO BE SUPPLIED BY OTHERS.
 2. OUTSIDE FLASHING DIMENSIONS OF CURB MATCH UNIT MANUFACTURERS CURB.
 3. SEE BULLETIN RC98 FOR TYPICAL INSTALLATION DETAILS AND ADJUSTMENT INSTRUCTIONS.
 4. FOR MANUFACTURING DETAILS, REFERENCE SUBSEQUENT DRAWING SHEETS.

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:

JOB NAME: _____
 CUSTOMER: _____
 CUSTOMER P.O.: _____
 SALES ORDER: _____

MODEL P-6200 ISOLATED SEISMIC WIND RESTRAINT ROOF CURB



SCALE: NONE

SHEET: _____

DRAWING NO.: VMA- _____

REVISION: _____

