


211R-103525 REV: 2



| REV. | DESCRIPTION | DATE | BY |
|------|-------------|------|----|
| | | | |

ROOFTOP EQUIPMENT

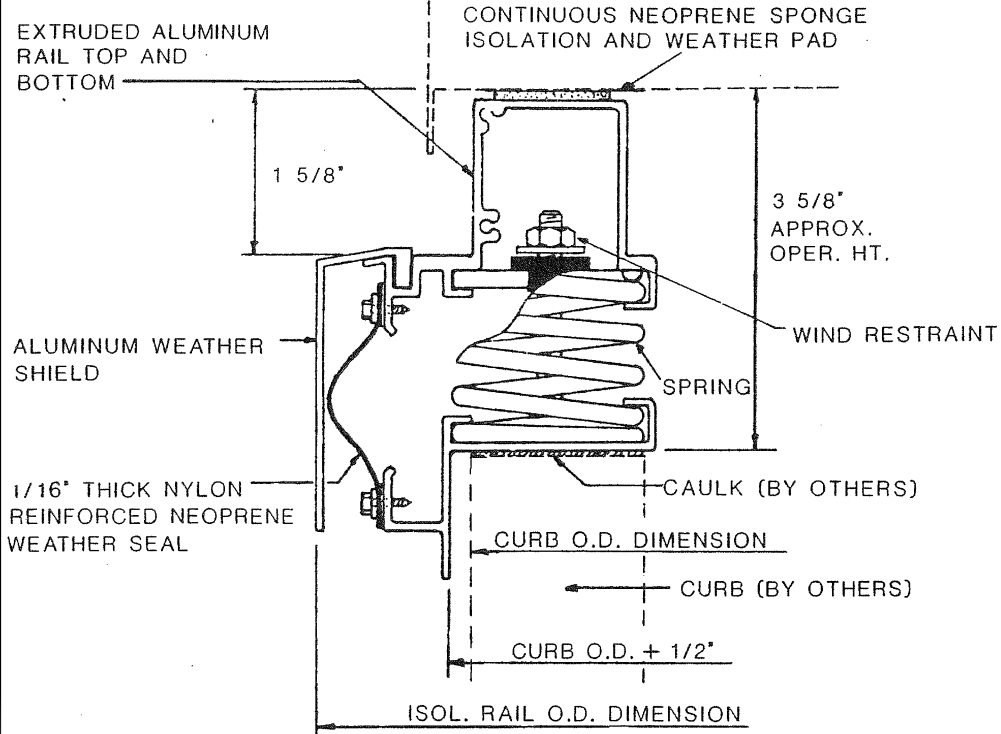

SECTION A-A

ROOFTOP EQUIPMENT

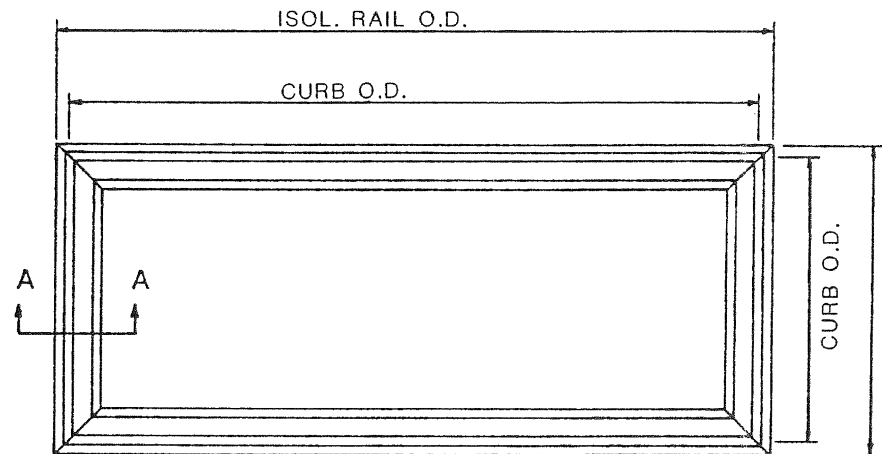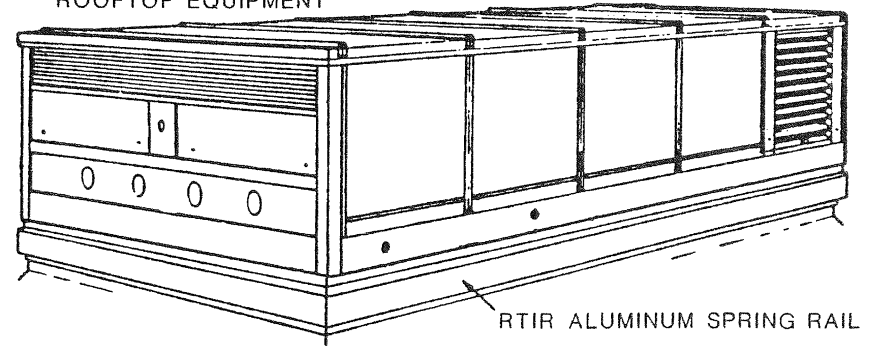

RAIL IS DESIGNED TO WITHSTAND A 60 M.P.H. WIND FORCE.



OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:

JOB NAME: _____
 CUSTOMER: _____
 CUSTOMER P.O.: _____
 SALES ORDER: _____

**MODEL RTIR ALUM. ROOFTOP ISOLATION
 RAIL 1 INCH DEFLECTION**



THE VMC GROUP
The Power of Together
 Bloomingdale, NJ 07403
 Houston, TX 77041

SCALE:

NONE

SHEET:



DRAWING NO.:

REVISION