

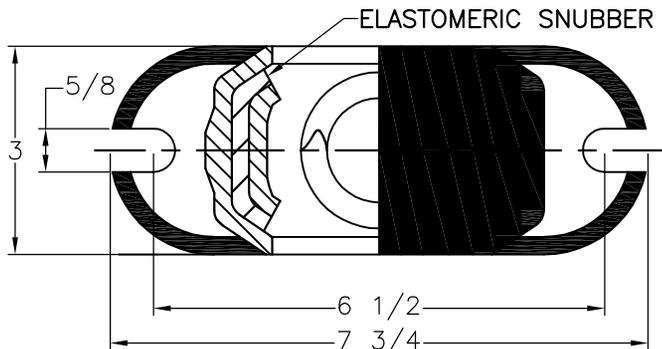


REV.	DESCRIPTION	DATE	BY

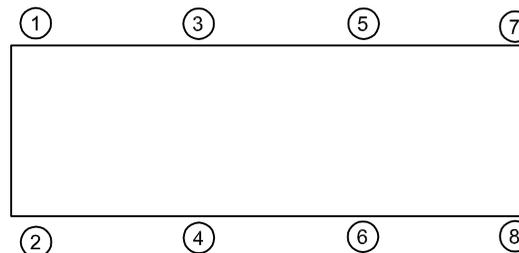

TYPE CDT-2B CAST IRON SPRING-FLEX MOUNTINGS WITH INTERNAL ADJUSTMENT				
MODEL	MAX LOAD (LBS.)	DEFLECTION (IN)	SPRING RATE (LB/IN)	SPRING COLOR CODE
CDT-2B-190	190	2.13	89	BLACK
CDT-2B-350	350	1.86	188	RED
CDT-2B-625	625	1.75	357	GRAY
CDT-2B-865N ¹	865	2.00	432	GRAY/ORANGE
CDT-2B-1000N ¹	1000	2.01	497	GRAY/DK BROWN

NOTES:
1. TWO NESTED SPRINGS YIELD THIS LOAD. THE COLOR CODE IS FOR OUTER SPRING/INNER SPRING.

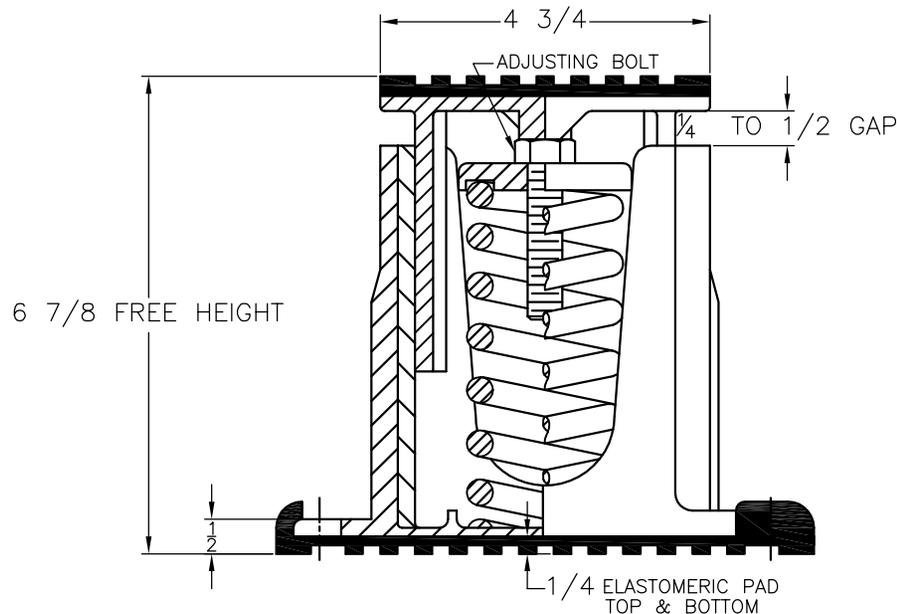

ISOLATOR SELECTIONS	
LOC 1:	LOC 2:
LOC 3:	LOC 4:
LOC 5:	LOC 6:
LOC 7:	LOC 8:
CUSTOMER EQP'T. TAG:	

NOTE: MATERIAL SHOWN IS FOR (1) SET.

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:

JOB NAME: _____

CUSTOMER: _____

CUSTOMER P.O.: _____

SALES ORDER: _____

MODEL CDT-2B 190-1000 LBS. HOUSED
CAST IRON SPRING-FLEX MOUNTS
SNUBBED WITH INTERNAL ADJUSTMENTS
2 INCH DEFLECTION



THE VMC GROUP
The Power of Together
Bloomingdale, NJ 07403
Houston, TX 77041

SCALE:

NONE

SHEET:

1 OF 2

DRAWING NO.:


REVISION



REV.	DESCRIPTION	DATE	BY

INSTALLATION INSTRUCTION

- ISOLATORS ARE SHIPPED FULLY ASSEMBLED AND ARE TOP BE SPACED AND ARRANGED IN ACCORDANCE WITH INSTALLATION DRAWINGS OR AS OTHERWISE RECOMMENDED.
- SET ISOLATORS ON FLOOR OR SUB-BASE, ENSURING THAT ALL ISOLATOR CENTERLINES MATCH THE EQUIPMENT MOUNTING HOLES. SHIM OR GROUT AS REQUIRED LEVELING ALL ISOLATOR BASE PLATES "E" AT THE SAME ELEVATION (1/4" MAXIMUM DIFFERENCE IN ELEVATION CAN BE TOLERATED). ISOLATOR BASE PLATES MUST REST ON A FLAT SURFACE.
- UNLESS SPECIFIED, MOUNTINGS NEED NOT BE FASTENED TO FLOOR IN ANY WAY. IF REQUIRED, BOLT MOUNTINGS TO FLOOR THROUGH SLOTS "D".
- PLACE MACHINE OR EQUIPMENT ONTO TOP PLATE "A" OF ISOLATOR. THE WEIGHT OF THE MACHINE WILL CAUSE THE UPPER HOUSING OF THE MOUNT TO GO DOWN, POSSIBLY RESTING ON THE LOWER HOUSING.
- ADJUST EACH ISOLATOR IN SEQUENCE: SCREW DOWN ONE COMPLETE TURN ON THE THE ADJUSTING BOLT "B" OF EACH MOUNTING. ADJUST UNTIL 1/4" GAP IS OBTAINED ON ALL MOUNTS.
- INSTALLATION COMPLETE.

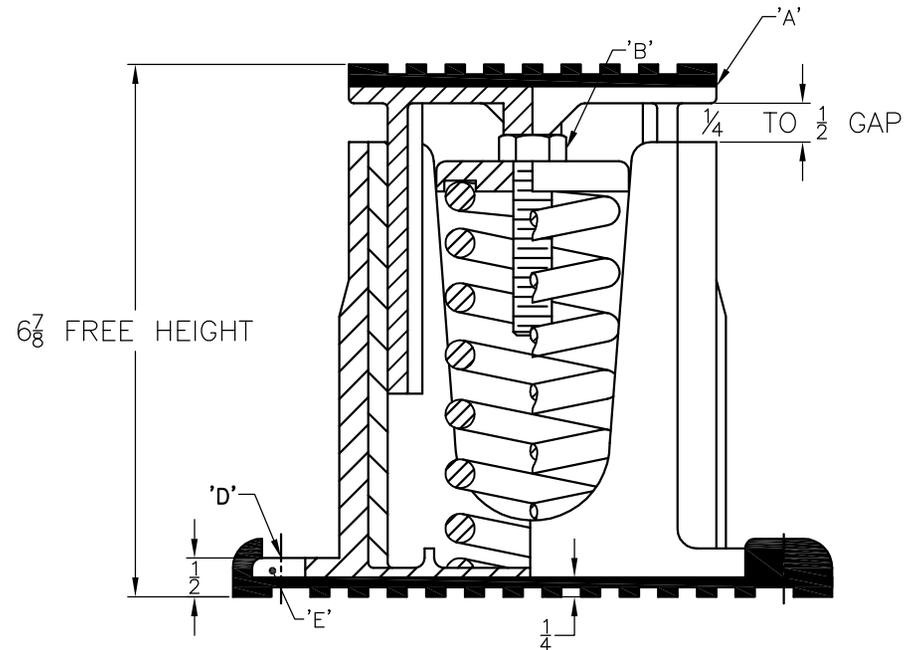

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:

JOB NAME: _____
 CUSTOMER: _____
 CUSTOMER P.O.: _____
 SALES ORDER: _____

**MODEL CDT-2B 190-1000 LBS. HOUSED
 CAST IRON SPRING-FLEX MOUNTS
 SNUBBED WITH INTERNAL ADJUSTMENTS
 2 INCH DEFLECTION**



THE VMC GROUP
The Power of Together
 Bloomingdale, NJ 07403
 Houston, TX 77041

SCALE:

NONE

SHEET:

2 OF 2

DRAWING NO.:

REVISION

