172R-101092 REV.: 8 5/8-11 UNC TAPPED HOLE 3/4 DIA HOLE FOR ATTACHMENT TO CONCRETE (4 TYP) 2 1/4 2 7/8 (BASE PLATE) 3/4 DIA HOLE FOR 7/8 ATTACHMENT TO STEEL (2 TYP) 1/2-13 UNC (VIEW CUT AWAY FOR CLARITY) TAPPED HOLE (2 TYP) STEEL SHIM 5/8 ADJUSTING NUT (REMOVE AFTER (2 TYP) SPRING ADJUSTMENT) - 3/8 GAP - ELASTOMERIC SNUBBER TU ПΠ 1/2 LIMIT STOP 8 1/8 (NOT SHOWN FREE & IN TOP VIEW OPERATING FOR CLARITY) HEIGHT **ELASTOMERIC (3/8)**

2. STANDARD FINISH: HOUSING - POWDER COAT (COLOR: BLACK), SPRING - POWDER COAT (COLOR: SEE TABLE),


7. RATED DEFLECTIONS ARE WITHIN 25% OF NOMINAL. HIGHER DEFLECTIONS ARE ALLOWED IF THEY MEET SPECIFICATIONS.

3. EQUIPMENT MUST BE BOLTED OR WELDED TO THE TOP PLATE TO MEET ALLOWABLE SEISMIC RATINGS.

4. ISOLATOR BASE PLATE MUST BE ANCHORED TO CONCRETE WITH (4) 11/16 DIA ANCHORS.

REV.	DESCRIPTION	DATE	BY

MODEL M2S-2D SEISMICALLY RESTRAINED VIBRATION ISOLATOR FOR 2" DEFLECTION								
SEISMIC MOUNT SIZE	RATED LOAD (LBS)	RATED DEFLECTION (IN)	SPRING RATE (LBS/IN)	COLOR CODE				
M2S-2D-870	870	1.89	460	RED				
M2S-2D-1200N	1200	1.88	638	RED/ BLACK				
M2S-2D-1450	1450	1.81	800	TAN				
M2S-2D-1690	1690	1.69	1000	PINK				
M2S-2D-2000N	2000	1.69	1184	PINK/BLACK				
M2S-2D-2640N	2640	1.54	1714	PINK/GRAY				
M2S-2D-2870N	2870	1.54	2004	PINK/ GRAY/				
				ORANGE				
M2S-2D-3280N	3280	1.54	2134	PINK/ GRAY/				
25 22 020014				DK. BROWN				



ISOLATOR SELECTIONS				
LOC 1:	LOC 2:			
LOC 3:	LOC 4:			
LOC 5:	LOC 6:			
LOC 7:	LOC 8:			
CUSTOMER EQP'T. TAG:				

NOTE: MATERIAL SHOWN IS FOR (1) SET.

CERTIFIED FOR:

JOB NAME: CUSTOMER: CUSTOMER P.O.: SALES ORDER:

1. ALL DIMENSIONS ARE IN INCHES, INTERPRET PER ANSI Y14.

5. ALL SPRINGS ARE DESIGNED FOR 50% OVERLOAD CAPACITY.

6. REFER TO SHEET 2 OF 2 FOR INSTALLATION INSTRUCTIONS.

HARDWARE ZINC-ELECTROPLATE.

MODEL M2S-2D 870-3280 LBS. VIBRATION ISOLATOR WITH INTEGRAL SEISMIC RESTRAINT AND INTERNAL ADJUSTMENT FOR 2 INCH DEFLECTION

THE VMC GROUP DRAWING NO. The Power of Together

Houston, TX 77041

NONE SHEET: 1 OF 2

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.


Bloomingdale, NJ 07403

REVISION

172R-101092 REV.: 8 DESCRIPTION REV. DATE BY

- 1. READ INSTRUCTIONS IN THEIR ENTIRETY BEFORE BEGINNING INSTALLATION.
- 2. ISOLATORS ARE SHIPPED FULLY ASSEMBLED AND ARE TO BE POSITIONED IN ACCORDANCE WITH THE SUBMITTAL DRAWINGS OR AS OTHERWISE RECOMMENDED.
- 3. SET ISOLATORS ON FLOOR, HOUSEKEEPING PAD, OR SUB-BASE, ENSURING THAT ALL ISOLATOR CENTERLINES MATCH THE EQUIPMENT MOUNTING HOLES. THE VMC GROUP RECOMMENDS THAT THE ISOLATOR BASE PLATES ("B") BE INSTALLED ON A LEVEL SURFACE. SHIM OR GROUT AS REQUIRED. LEVELING ALL ISOLATOR BASE PLATES AT THE SAME ELEVATION (1/4-INCH MAXIMUM DIFFERENCE CAN BE TOLERATED).
- 4. ANCHOR ALL ISOLATORS TO THE FLOOR, HOUSEKEEPING PAD, OR SUB-BASE USING THRU HOLES ("C") FOR CONCRETE OR ("D") FOR STEEL AS REQUIRED. USE ANCHORS MEETING THE DESIGN REQUIREMENTS SPECIFIED ON SHEET 1 OF 2. WELDING TO STEEL IS PERMITTED PROVIDING THE WELD ACHIEVES THE REQUIRED STRENGTH.
- 5. ISOLATORS ARE SHIPPED TO THE JOBSITE WITH (2) REMOVABLE SPACER SHIMS ("E") BETWEEN THE TOP PLATE AND THE HOUSING. THESE SHIMS MUST BE IN PLACE WHEN THE EQUIPMENT IS POSITIONED OVER THE ISOLATORS.
- 6. WITH ALL SHIMS ("E") IN PLACE, PLACE THE MACHINE OR EQUIPMENT ONTO TOP PLATE ("A") OF THE ISOLATORS. BOLT EQUIPMENT SECURELY TO THE ISOLATORS USING MINIMUM ASTM A325 SAE GR. 5) HIGH-STRENGTH BOLTS, MEETING THE REQUIREMENTS (IF ANY) SPECIFIED ON SHEET 1 OF 2. WELDING IS PERMITTED PROVIDING THE WELD ACHIEVES THE REQUIRED STRENGTH.

- 7. THE ADJUSTMENT PROCESS CAN ONLY BEGIN AFTER THE EQUIPMENT OR MACHINE IS AT ITS FULL OPERATING WEIGHT.
- 8. BACK OFF EACH OF THE (2) OR (4) LIMIT STOP LOCKNUTS ("F") PER ISOLATOR 1/4- TO 3/8-INCH.
- 9. ADJUST EACH ISOLATOR IN SEQUENCE BY TURNING ADJUSTING NUT(S) "G" ONE FULL CLOCKWISE TURN AT A TIME, REPEAT THIS PROCEDURE ON ALL ISOLATORS, ONE AT A TIME, CHECK THE LIMIT STOP LOCKNUTS ("F") PERIODICALLY TO ENSURE THAT CLEARANCE BETWEEN THE WASHER AND RUBBER GROMMET IS MAINTAINED. STOP ADJUSTMENT OF AN ISOLATOR ONLY WHEN THE TOP PLATE ("A") HAS RISEN JUST ABOVE THE SHIM ("E").
- 10. REMOVE ALL SPACER SHIMS ("E").
- 11. FINE ADJUST ISOLATORS TO LEVEL EQUIPMENT.
- 12. ADJUST ALL LIMIT STOP LOCKNUTS ("F") PER ISOLATOR TO OBTAIN 3/8-INCH GAP. THE LIMIT STOP NUTS MUST BE KEPT AT THIS 3/8-INCH GAP TO ENSURE UNIFORM BOLT LOADING DURING UPLIFT (AS IN THE CASE WHEN A COOLING TOWER IS DRAINED).
- 13. INSTALLATION IS COMPLETE.

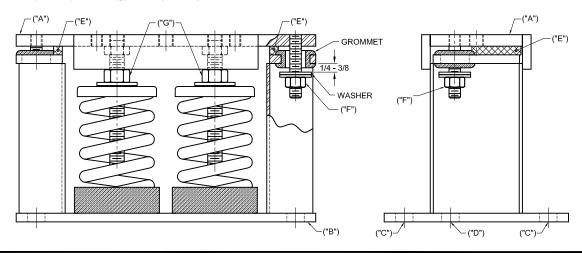

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE

JOB NAME:	
_	

CERTIFIED FOR:

CUSTOMER:

SALES ORDER:

CUSTOMER P.O.:

MODEL M2S-2D 870-3280 LBS. VIBRATION ISOLATOR WITH INTEGRAL SEISMIC RESTRAINT AND INTERNAL ADJUSTMENT FOR 2 INCH DEFLECTION

THE VMC GROL	11

The Power of Together Bloomingdale, NJ 07403

Houston, TX 77041

NONE SHEET: 2 OF 2

P DRAWING NO.:

SCALE:

REVISION